


SECTION 25-9-6(a) of Georgia Law mandates that you must notify the Utilities Protection Center (800-282-7411) a minimum of 48 hours prior to excavating with mechanical equipment. Failure to follow the law will subject you to a \$10,000.00 fine. Also, If you hire a contractor to perform the excavation and they fail to call before digging, You may be held liable for any damage that they may cause. CALL BEFORE YOU DIG!!!

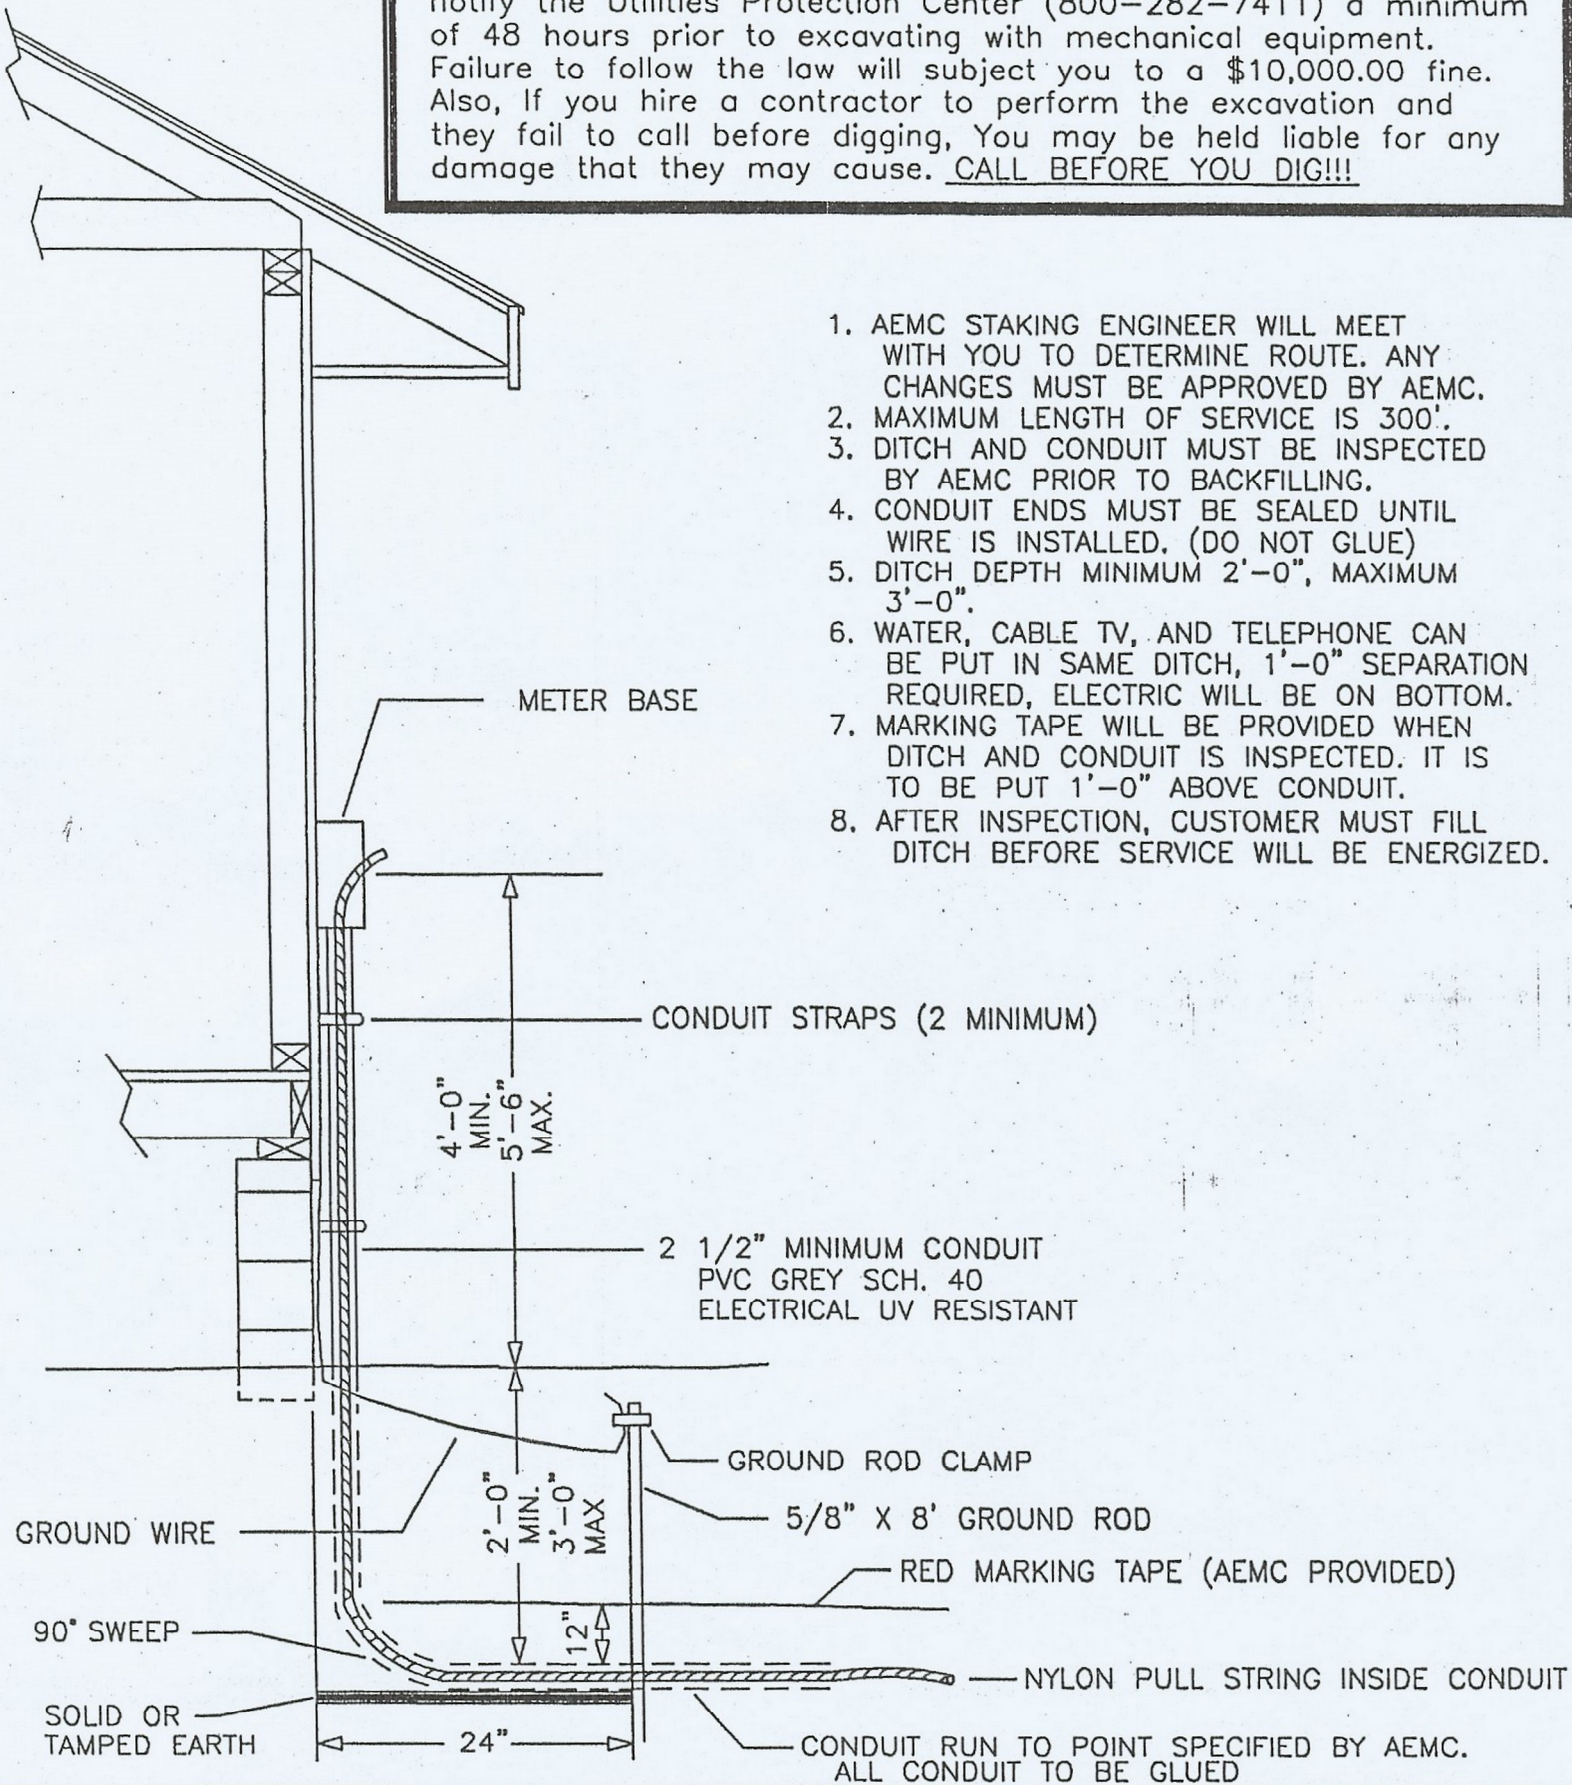

1. AEMC STAKING ENGINEER WILL MEET WITH YOU TO DETERMINE ROUTE. ANY CHANGES MUST BE APPROVED BY AEMC.
2. MAXIMUM LENGTH OF SERVICE IS 300'.
3. DITCH AND CONDUIT MUST BE INSPECTED BY AEMC PRIOR TO BACKFILLING.
4. CONDUIT ENDS MUST BE SEALED UNTIL WIRE IS INSTALLED. (DO NOT GLUE)
5. DITCH DEPTH MINIMUM 2'-0", MAXIMUM 3'-0".
6. WATER, CABLE TV, AND TELEPHONE CAN BE PUT IN SAME DITCH, 1'-0" SEPARATION REQUIRED, ELECTRIC WILL BE ON BOTTOM.
7. MARKING TAPE WILL BE PROVIDED WHEN DITCH AND CONDUIT IS INSPECTED. IT IS TO BE PUT 1'-0" ABOVE CONDUIT.
8. AFTER INSPECTION, CUSTOMER MUST FILL DITCH BEFORE SERVICE WILL BE ENERGIZED.

ALL MATERIAL SHOWN ON DRAWINGS TO BE FURNISHED BY CUSTOMER UNLESS OTHERWISE NOTED.

METER BASE / CONDUIT INSTALLATION UNDERGROUND

DATE: AUG. 2001

AMICALOLA E.M.C.
JASPER, GA.

DRAWING NO

DRAWN BY: MARVIN MOORE

APPROVED BY: STEVE TIMMONS

SPEC7